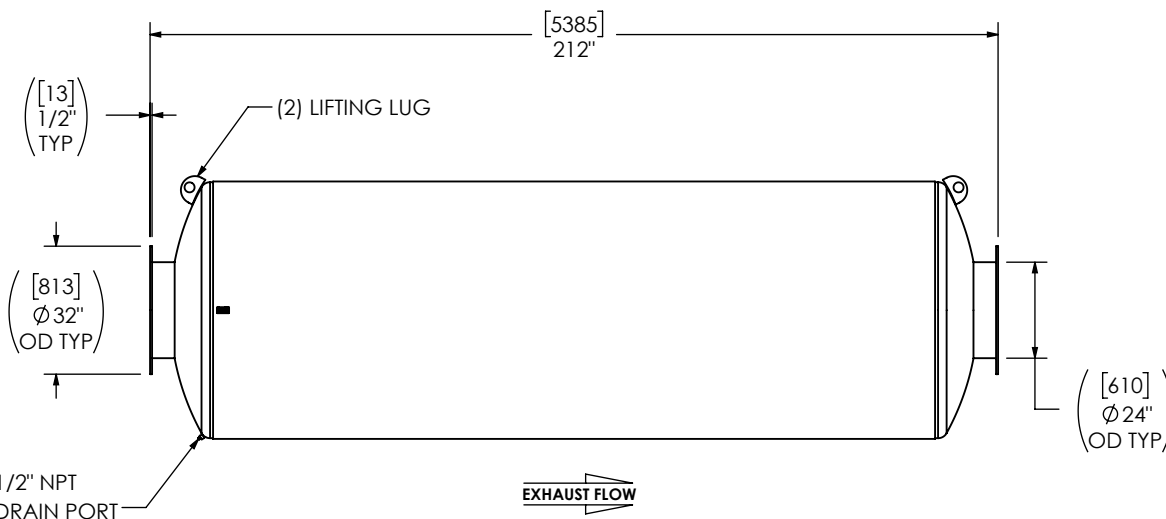



(2) 24" FF FLANGE  
150 lb ANSI  
STANDARD  
BOLT PATTERN

[1626]  
Ø 64"  
NOM DIA

[35]  
Ø 1 3/8"  
TYP

[749]  
Ø 29 1/2"  
BCD



#### NOTES:



- DO NOT USE EQUIPMENT TO SUPPORT OTHER PARTS OF THE EXHAUST SYSTEM WITHOUT PROPER REINFORCEMENT

#### MATERIAL CONSTRUCTION:

- 304 STAINLESS STEEL

#### PAINT:

- NONE  
(MIRATECH COATING SYSTEM 4)

PROJECT NAME	<div>PROPRIETARY AND CONFIDENTIAL</div> <div>THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF MIRATECH. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF MIRATECH IS PROHIBITED.</div> <div>PROJECTION</div> <div></div>	ALL DIMENSIONS IN INCHES [MILLIMETERS] UNLESS OTHERWISE SPECIFIED.			
PROPOSAL NUMBER		CRITICAL DIMENSIONS ARE <span>CIRCLED</span>			
SALES ORDER NO.		TOLERANCES UNLESS OTHERWISE SPECIFIED		<div>M6EE0-24PF-3-00000000</div> <div>SILENCER SUPER HOSPITAL GRADE M62</div>	
CUSTOMER P.O. [P.N.]		<div><div><div>DRAWN</div><div>AVK</div></div><div><div>DATE</div><div>2025-05-02</div></div></div> <div><div><div>REVIEWED</div><div>CSF</div></div><div><div>DATE</div><div>2025-05-02</div></div></div>			